


Distribution of Light Attenuation Coefficients by Sarasota County Water Clarity Segment

Parameter=Kd

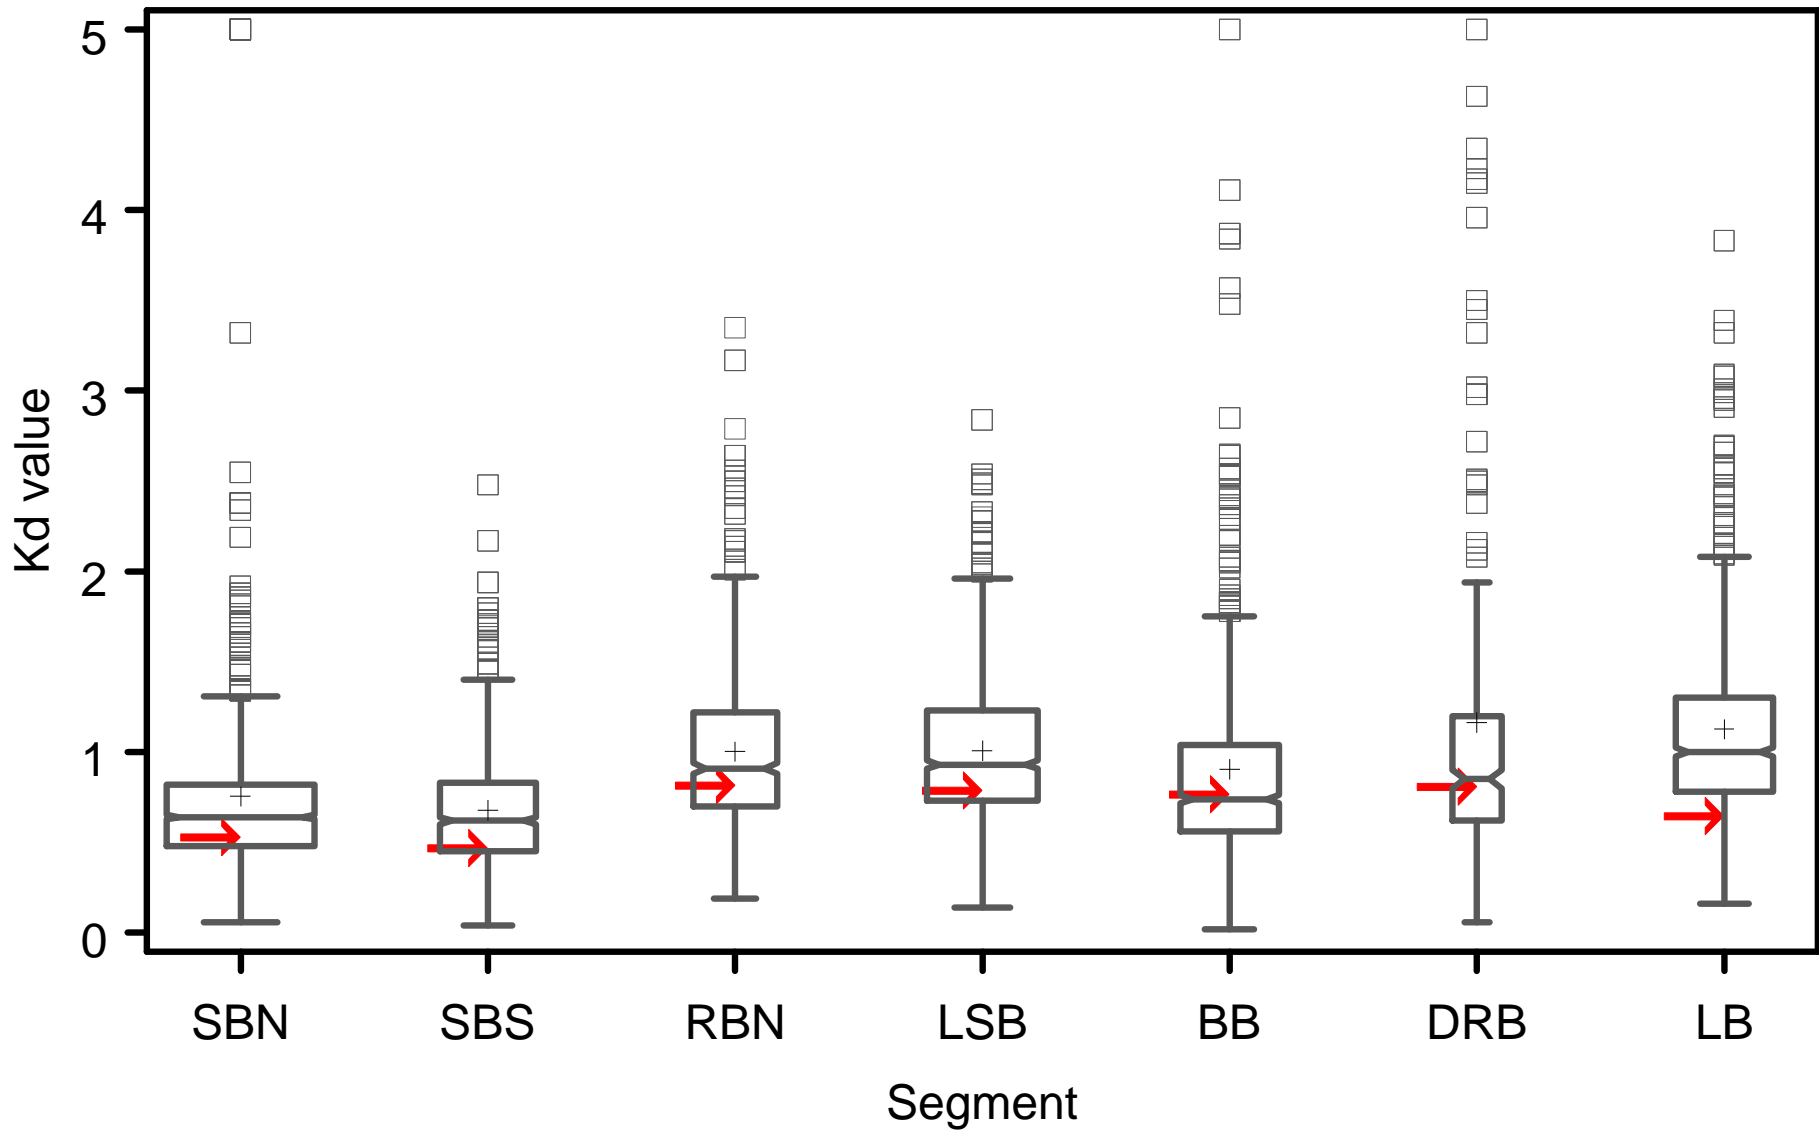


Box width varies with n

Arrow indicates the target (40%) Kd value

Distribution of Light Attenuation Coefficients by Sarasota County Water Clarity Segment

Segment=SBN Parameter=Kd

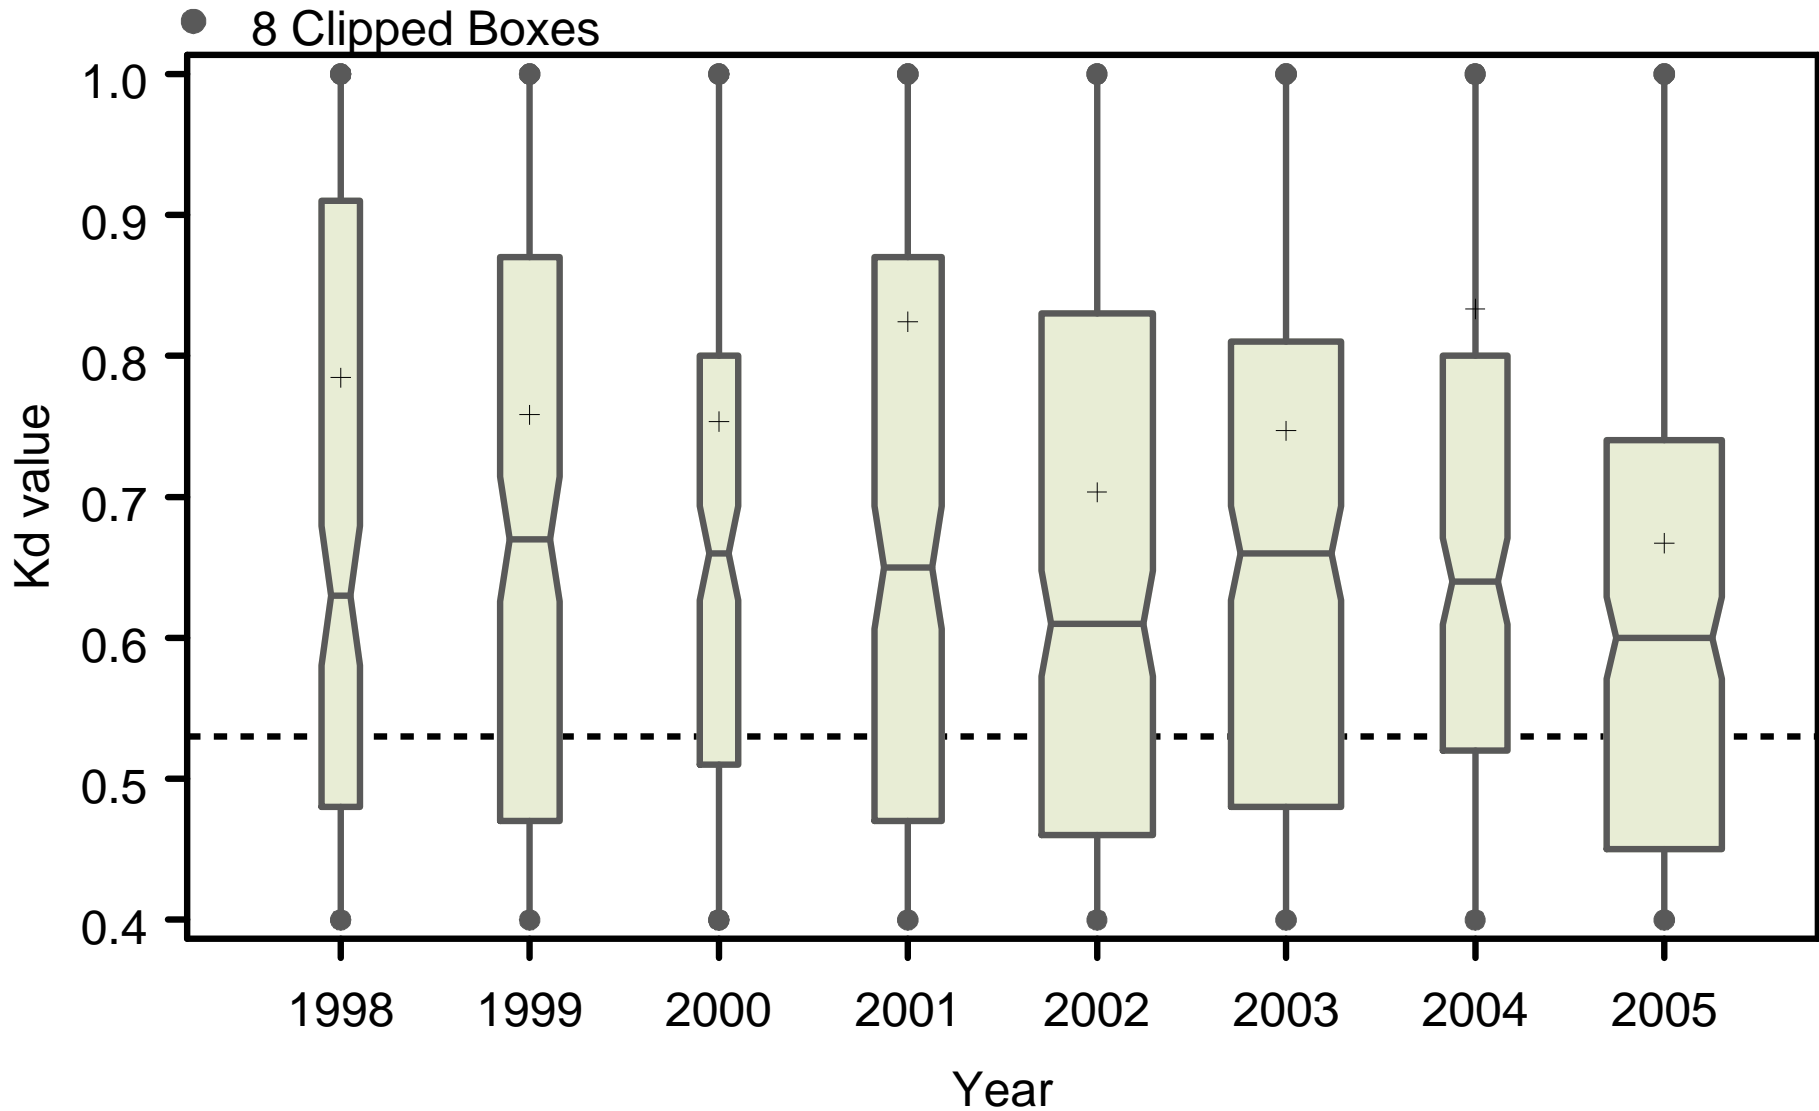


Box width varies with n

Horizontal line indicates the target (40%) Kd value

Distribution of Light Attenuation Coefficients by Sarasota County Water Clarity Segment

Segment=SBS Parameter=Kd

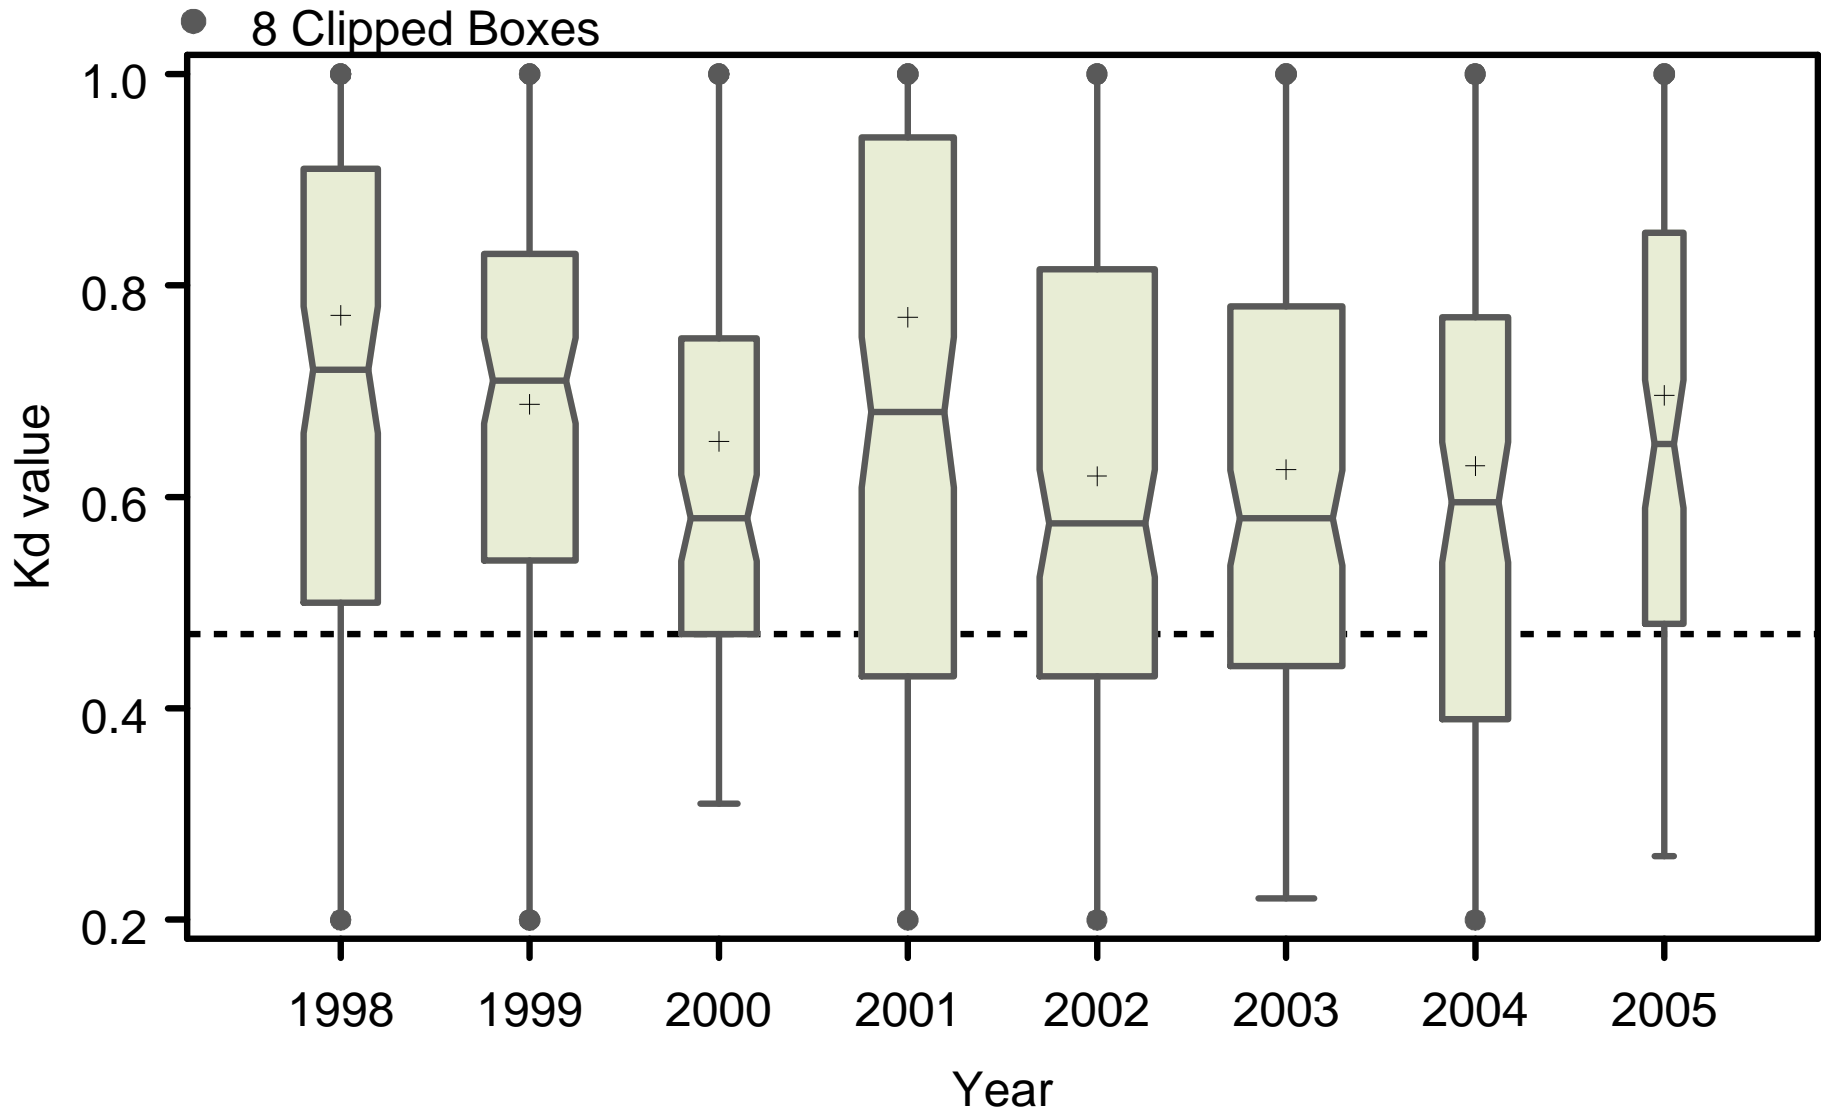


Box width varies with n

Horizontal line indicates the target (40%) Kd value

Distribution of Light Attenuation Coefficients by Sarasota County Water Clarity Segment

Segment=RBN Parameter=Kd

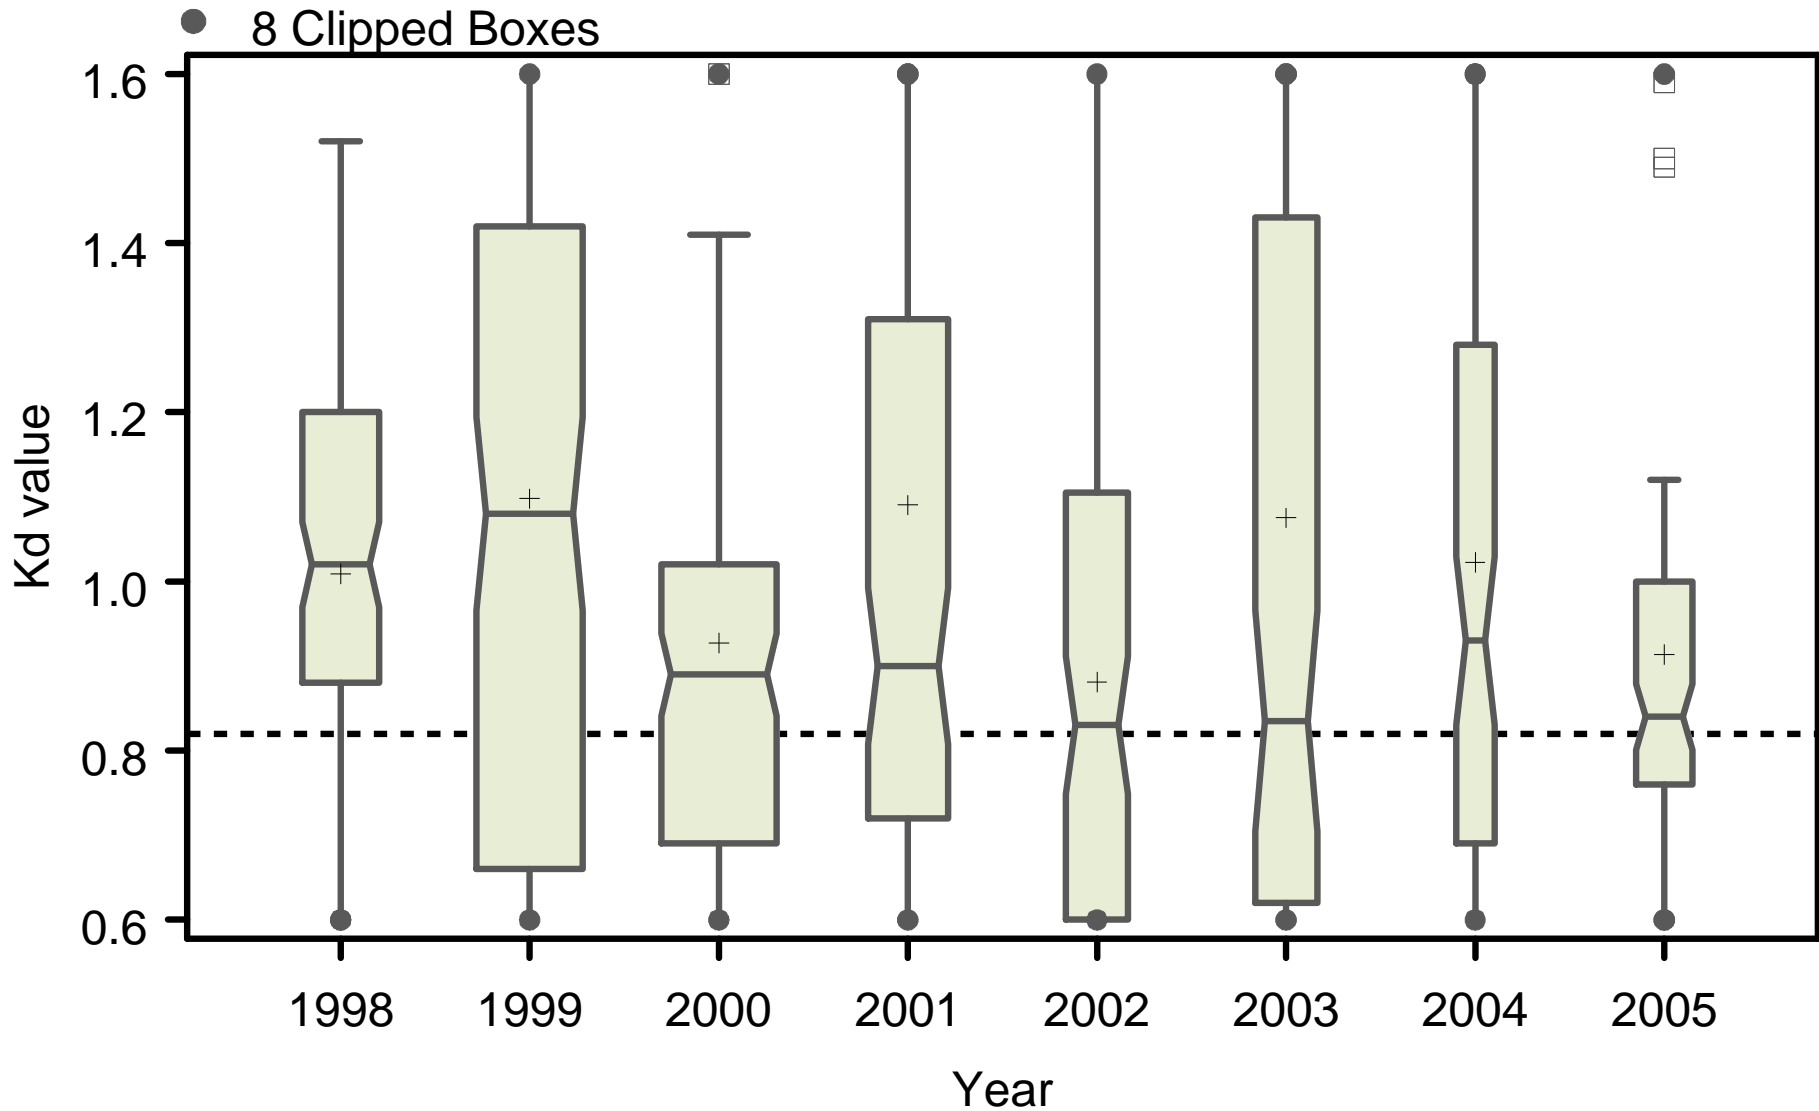


Box width varies with n

Horizontal line indicates the target (40%) Kd value

Distribution of Light Attenuation Coefficients by Sarasota County Water Clarity Segment

Segment=LSB Parameter=Kd

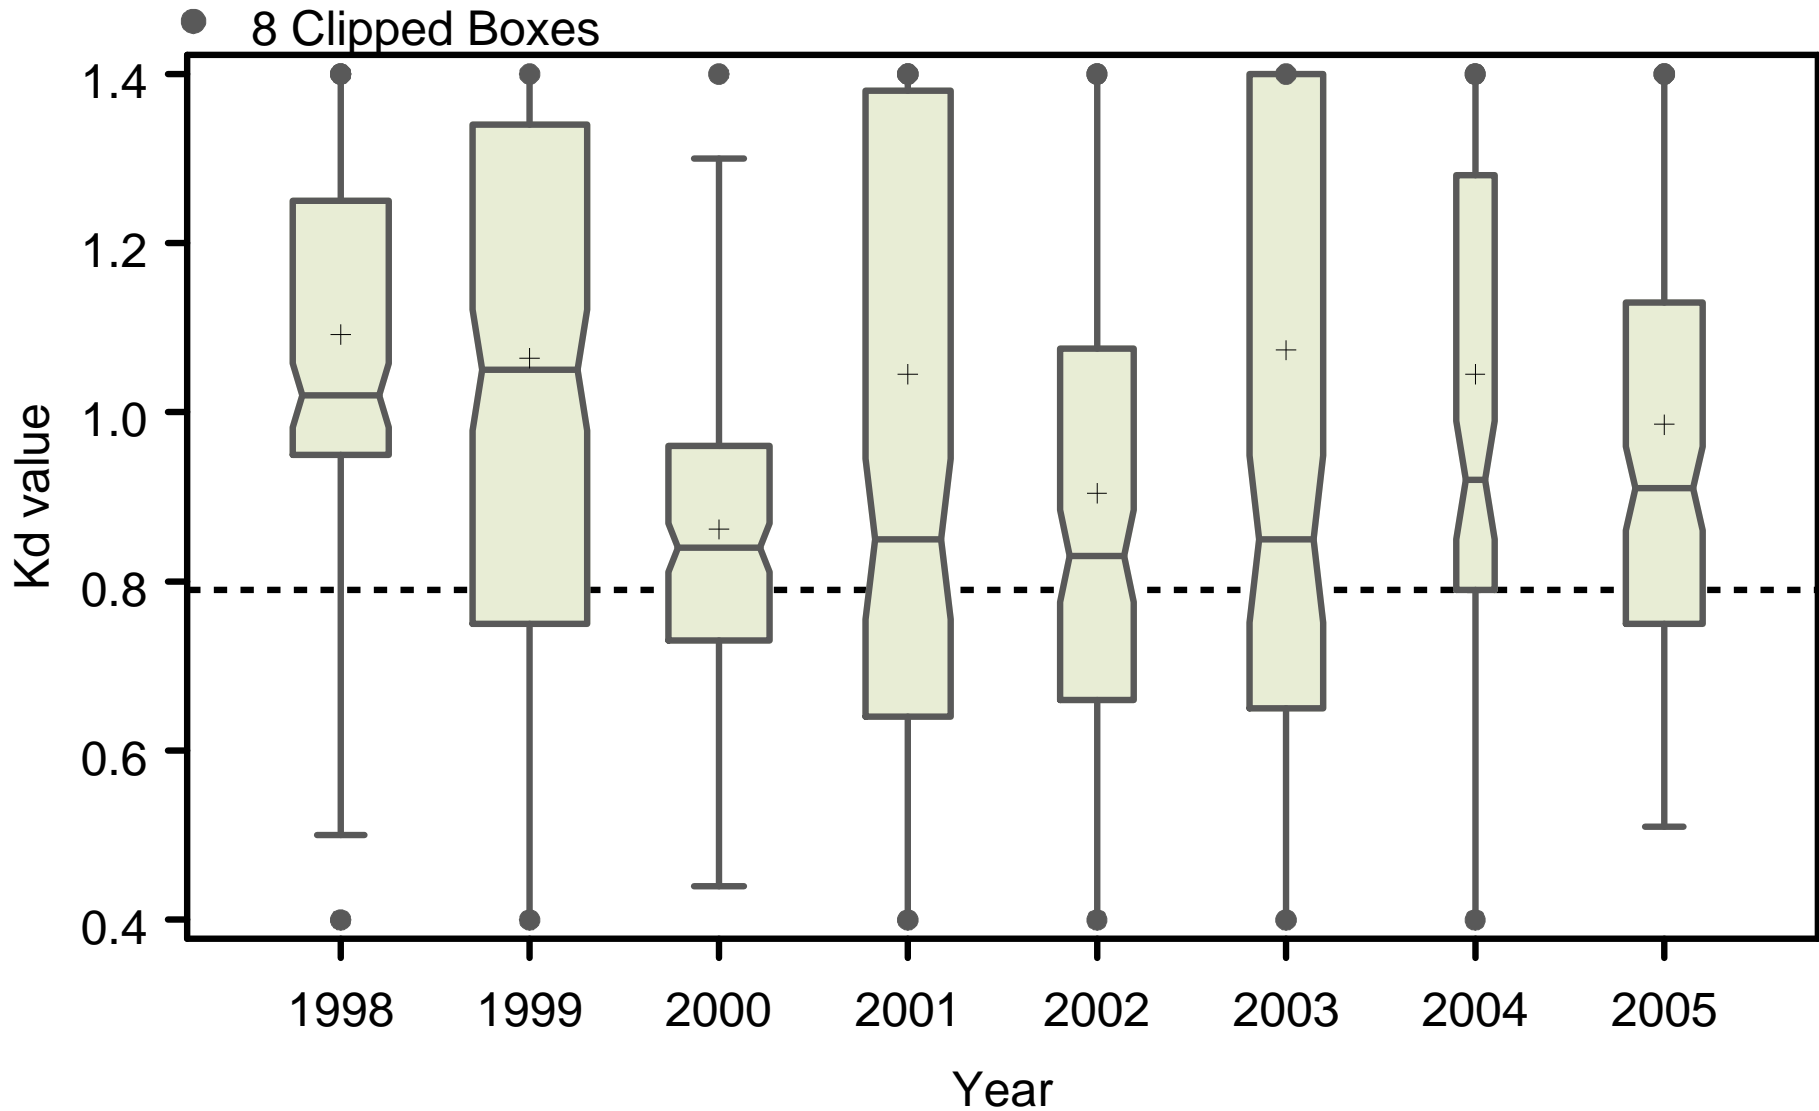


Box width varies with n

Horizontal line indicates the target (40%) Kd value

Distribution of Light Attenuation Coefficients by Sarasota County Water Clarity Segment


Segment=BB Parameter=Kd

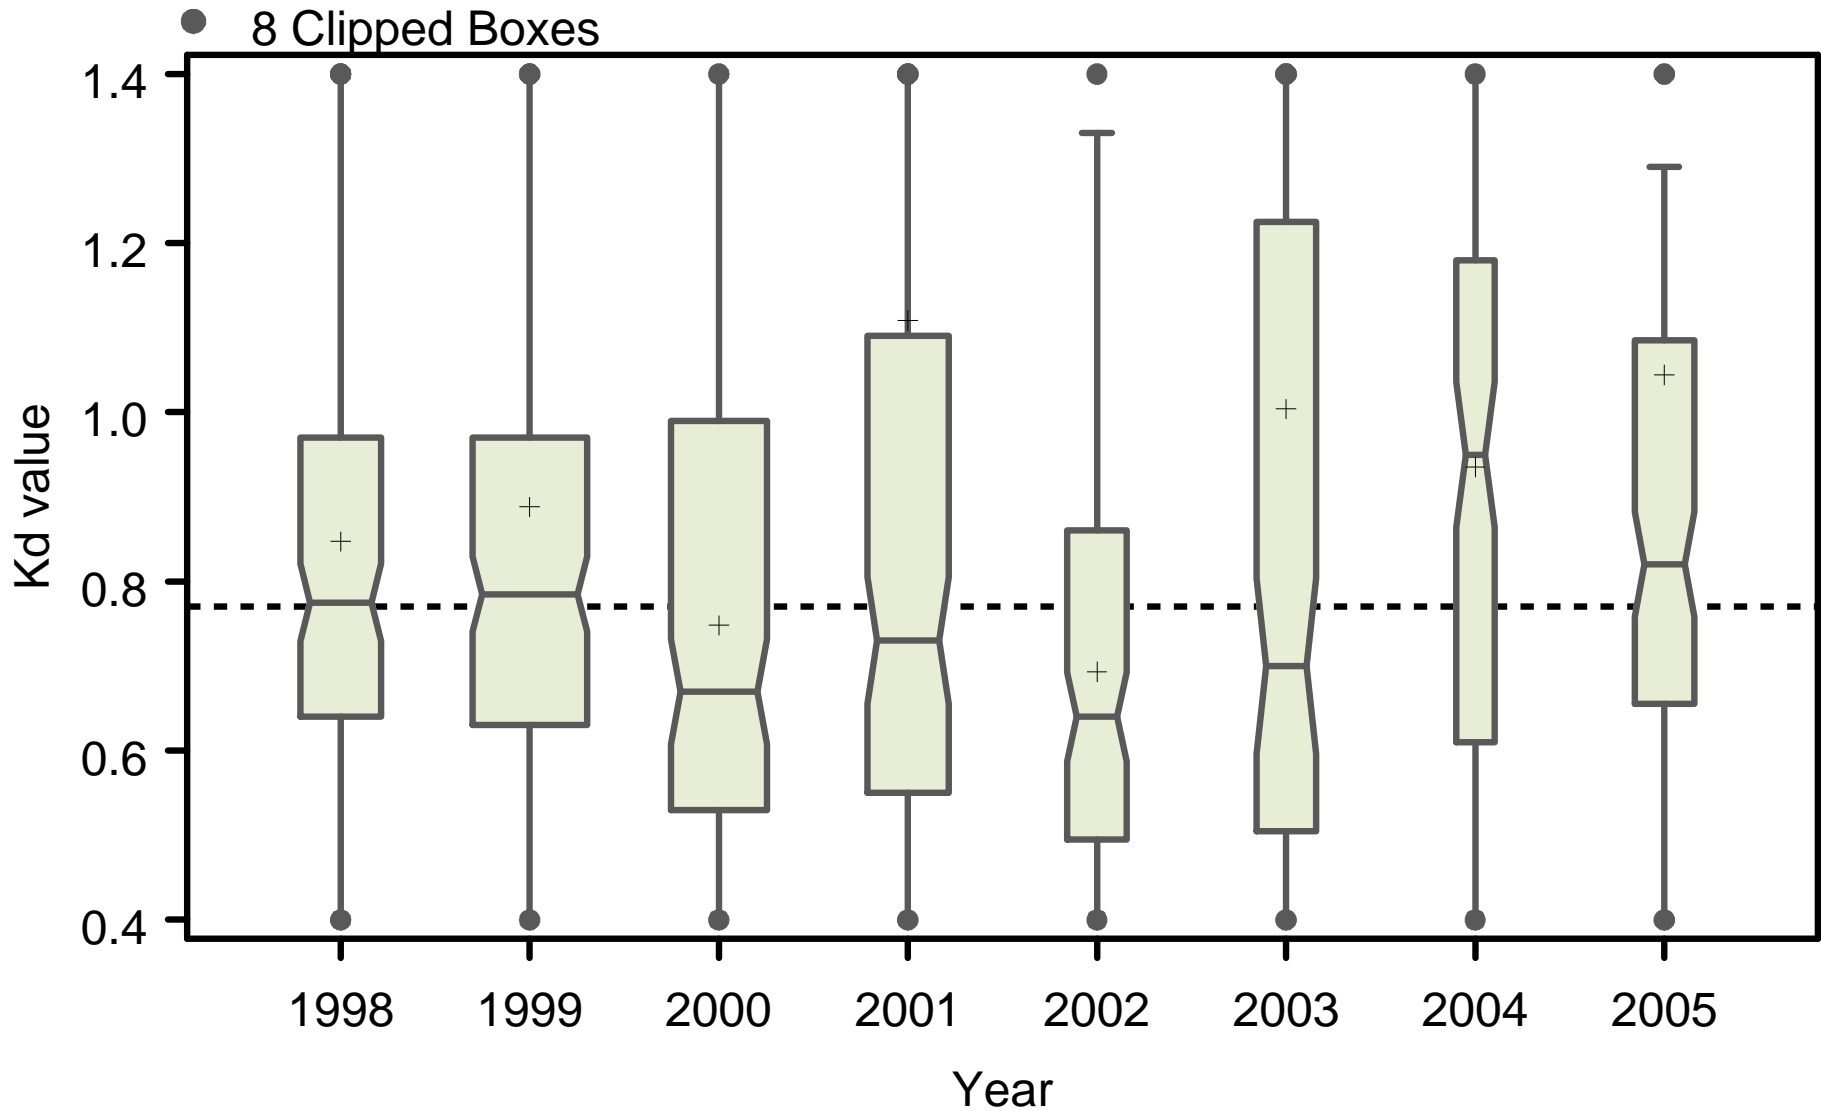

Box width varies with n

Horizontal line indicates the target (40%) Kd value

Distribution of Light Attenuation Coefficients by Sarasota County Water Clarity Segment Segment=DRB Parameter=Kd

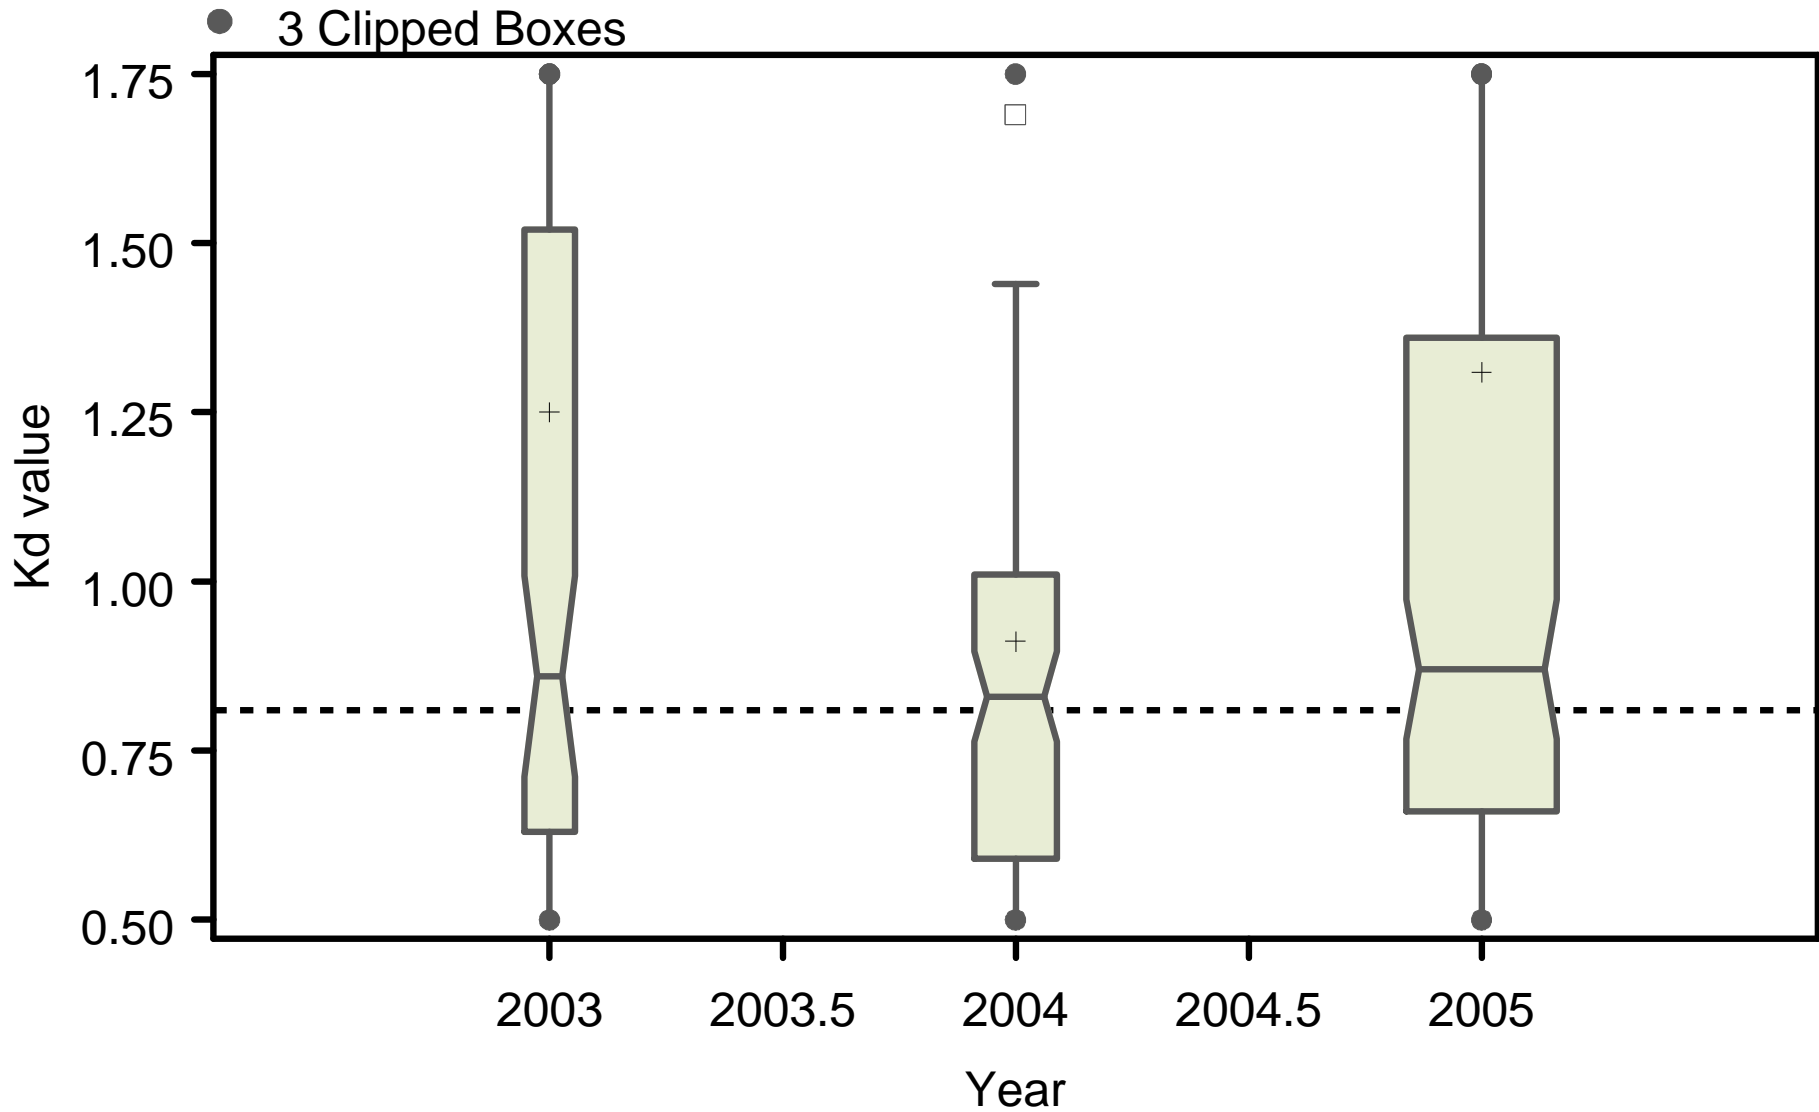


Box width varies with n

Horizontal line indicates the target (40%) Kd value

Distribution of Light Attenuation Coefficients by Sarasota County Water Clarity Segment

Segment=LB Parameter=Kd

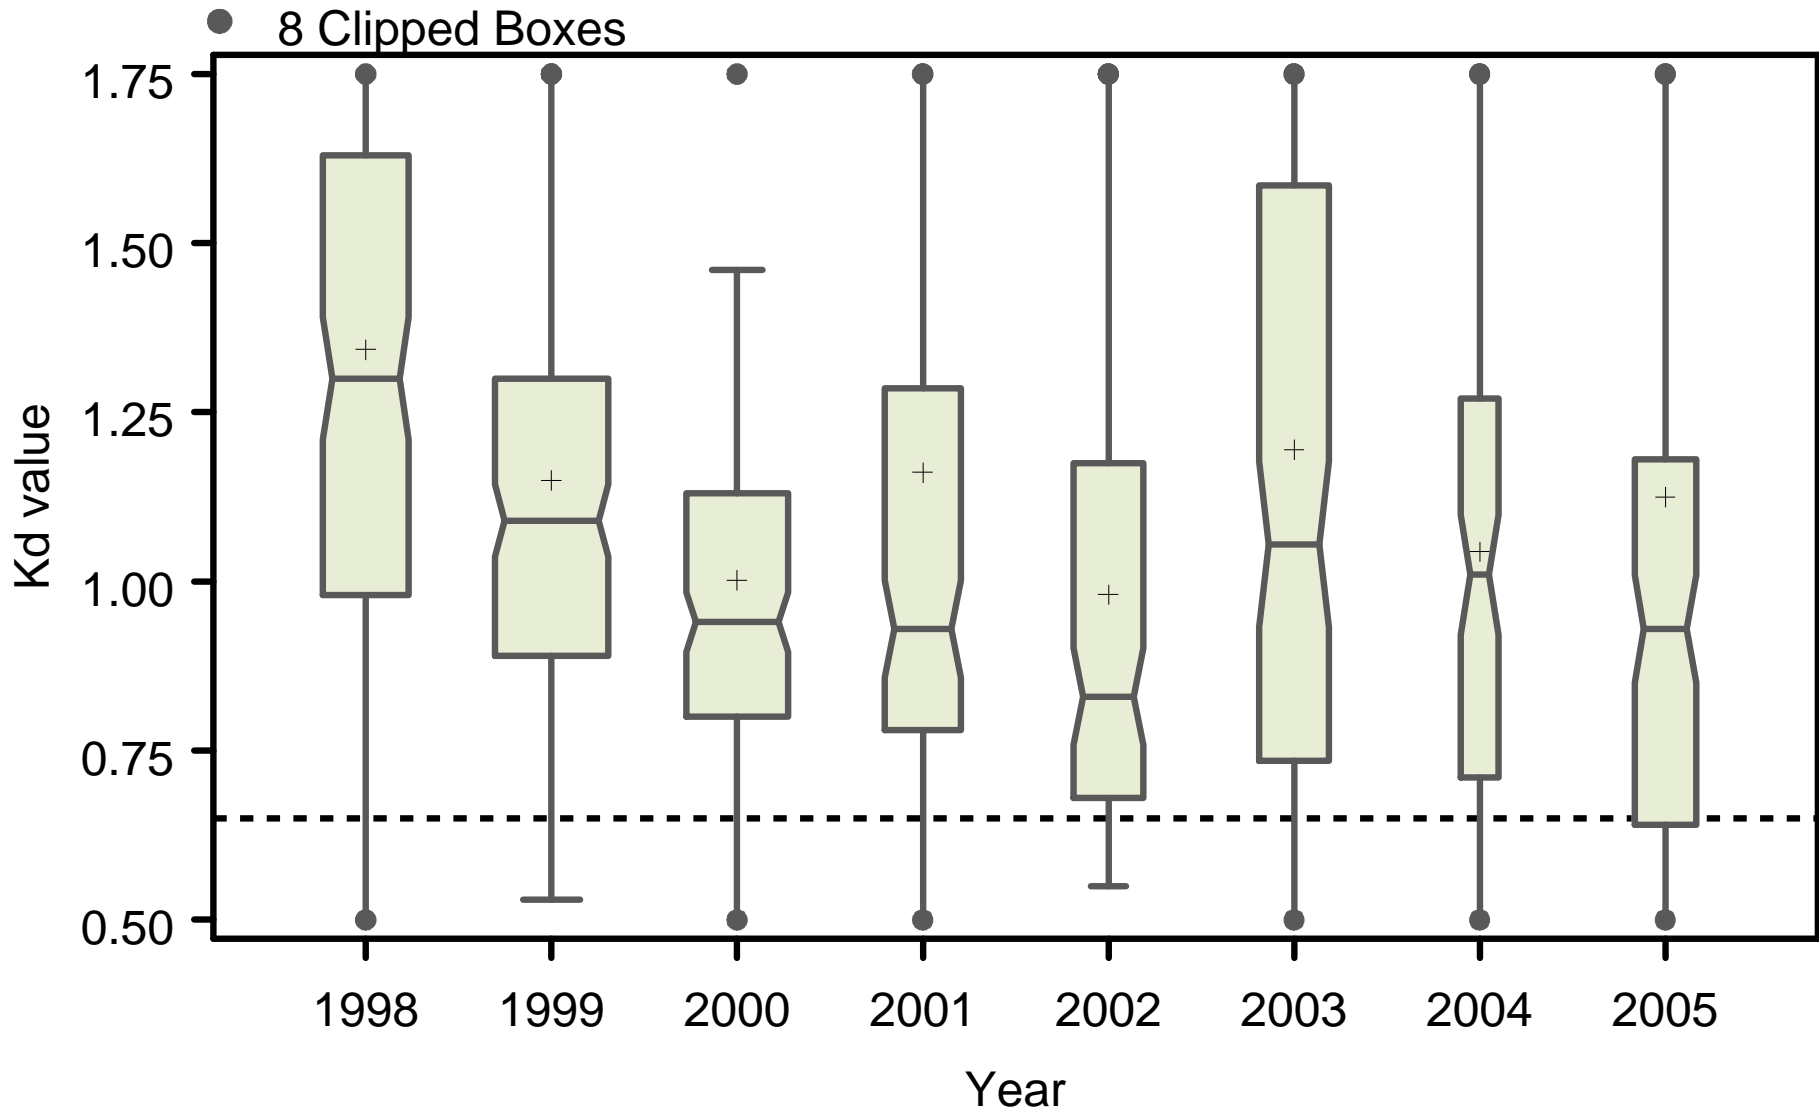


Box width varies with n

Horizontal line indicates the target (40%) Kd value

Distribution of Light Attenuation Coefficients by Sarasota County Water Clarity Segment

Segment=SBN Parameter=Kd

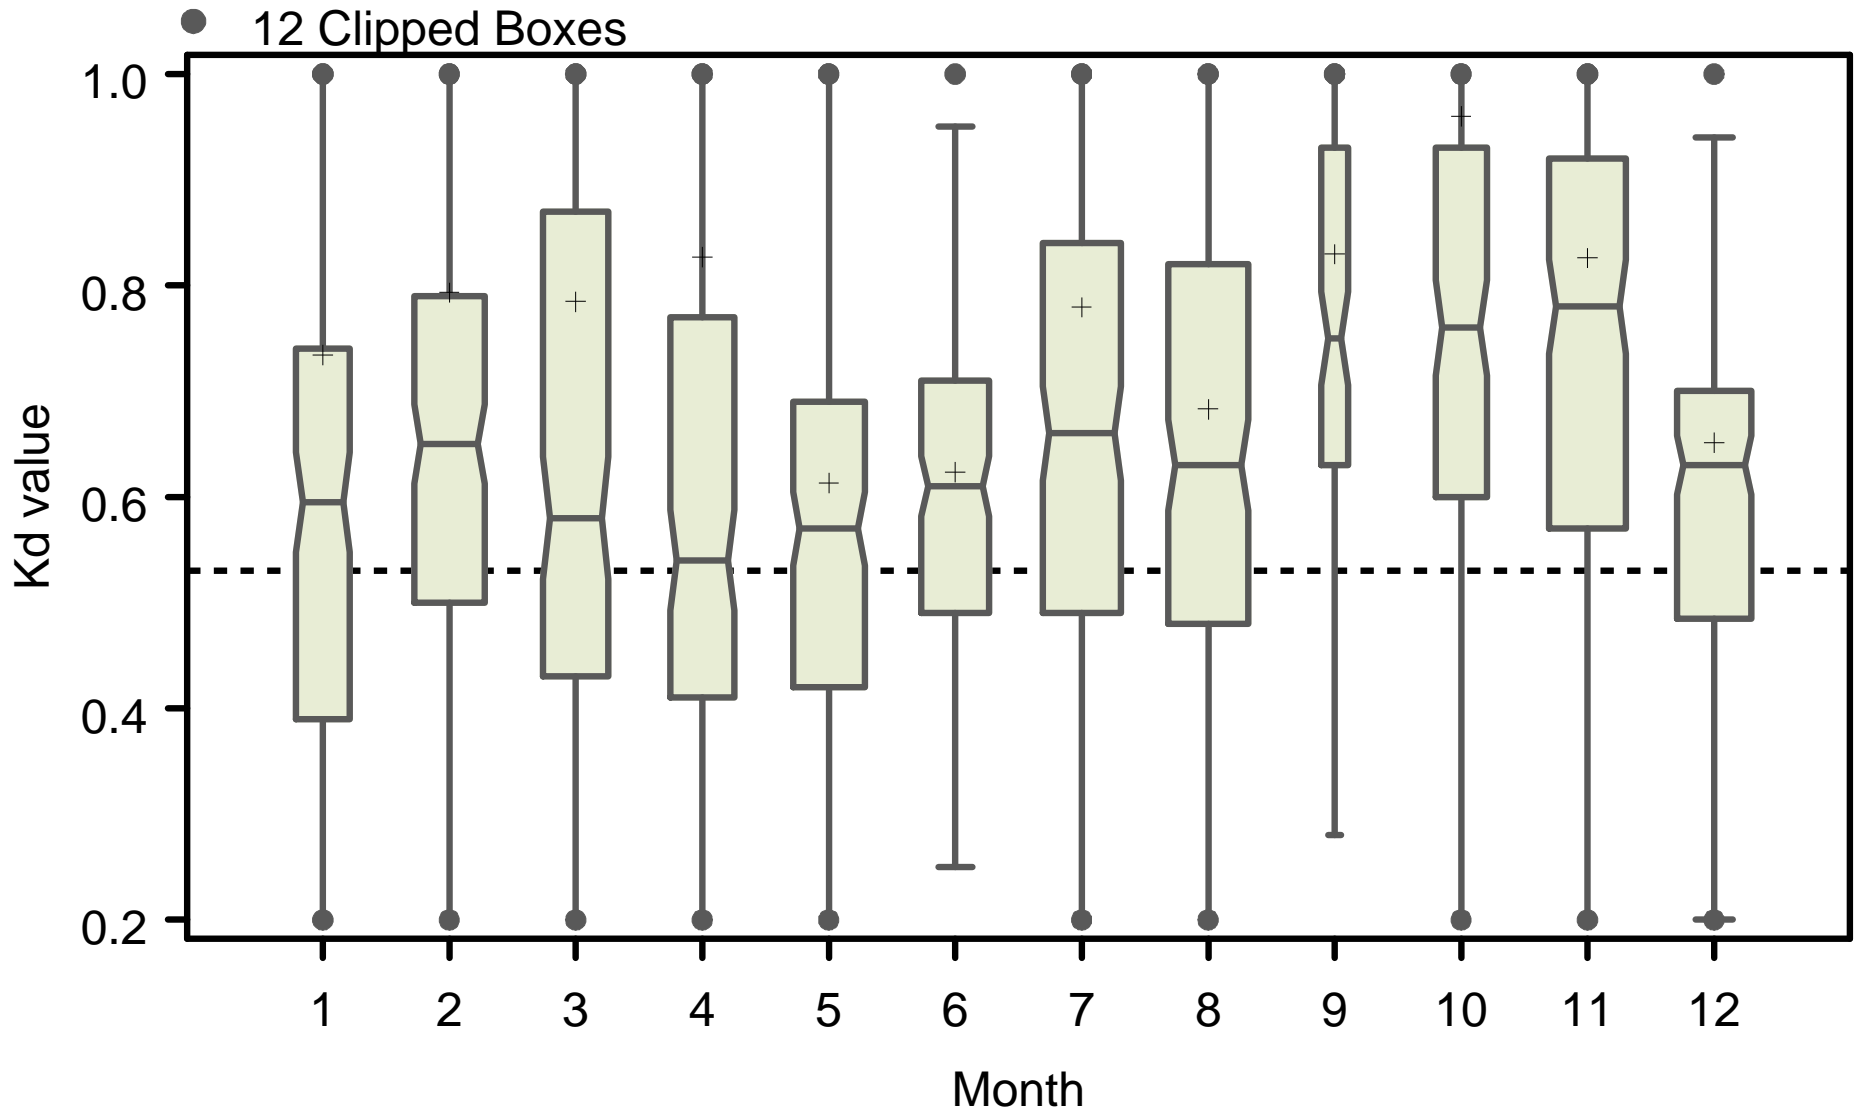


Box width varies with n

Horizontal line indicates the target(40%) Kd value

Distribution of Light Attenuation Coefficients by Sarasota County Water Clarity Segment

Segment=SBS Parameter=Kd

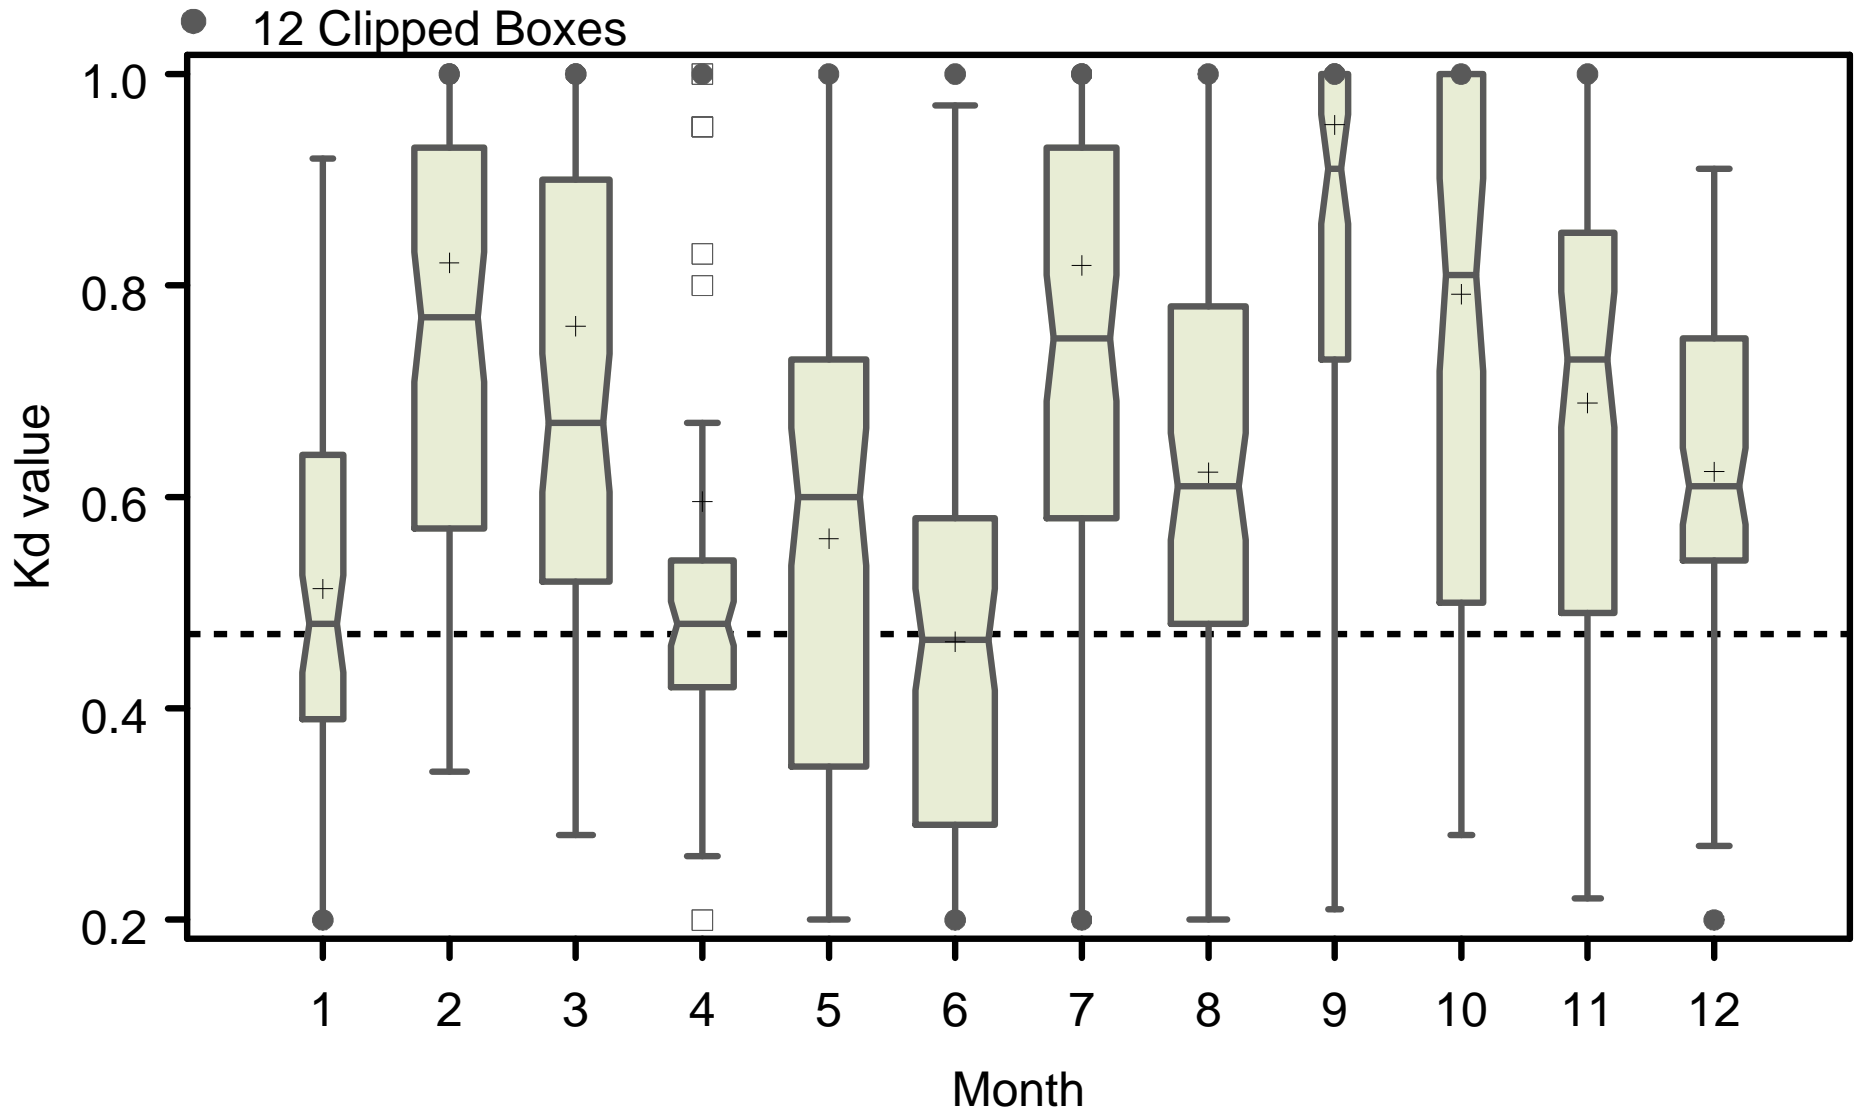


Box width varies with n

Horizontal line indicates the target(40%) Kd value

Distribution of Light Attenuation Coefficients by Sarasota County Water Clarity Segment

Segment=RBN Parameter=Kd

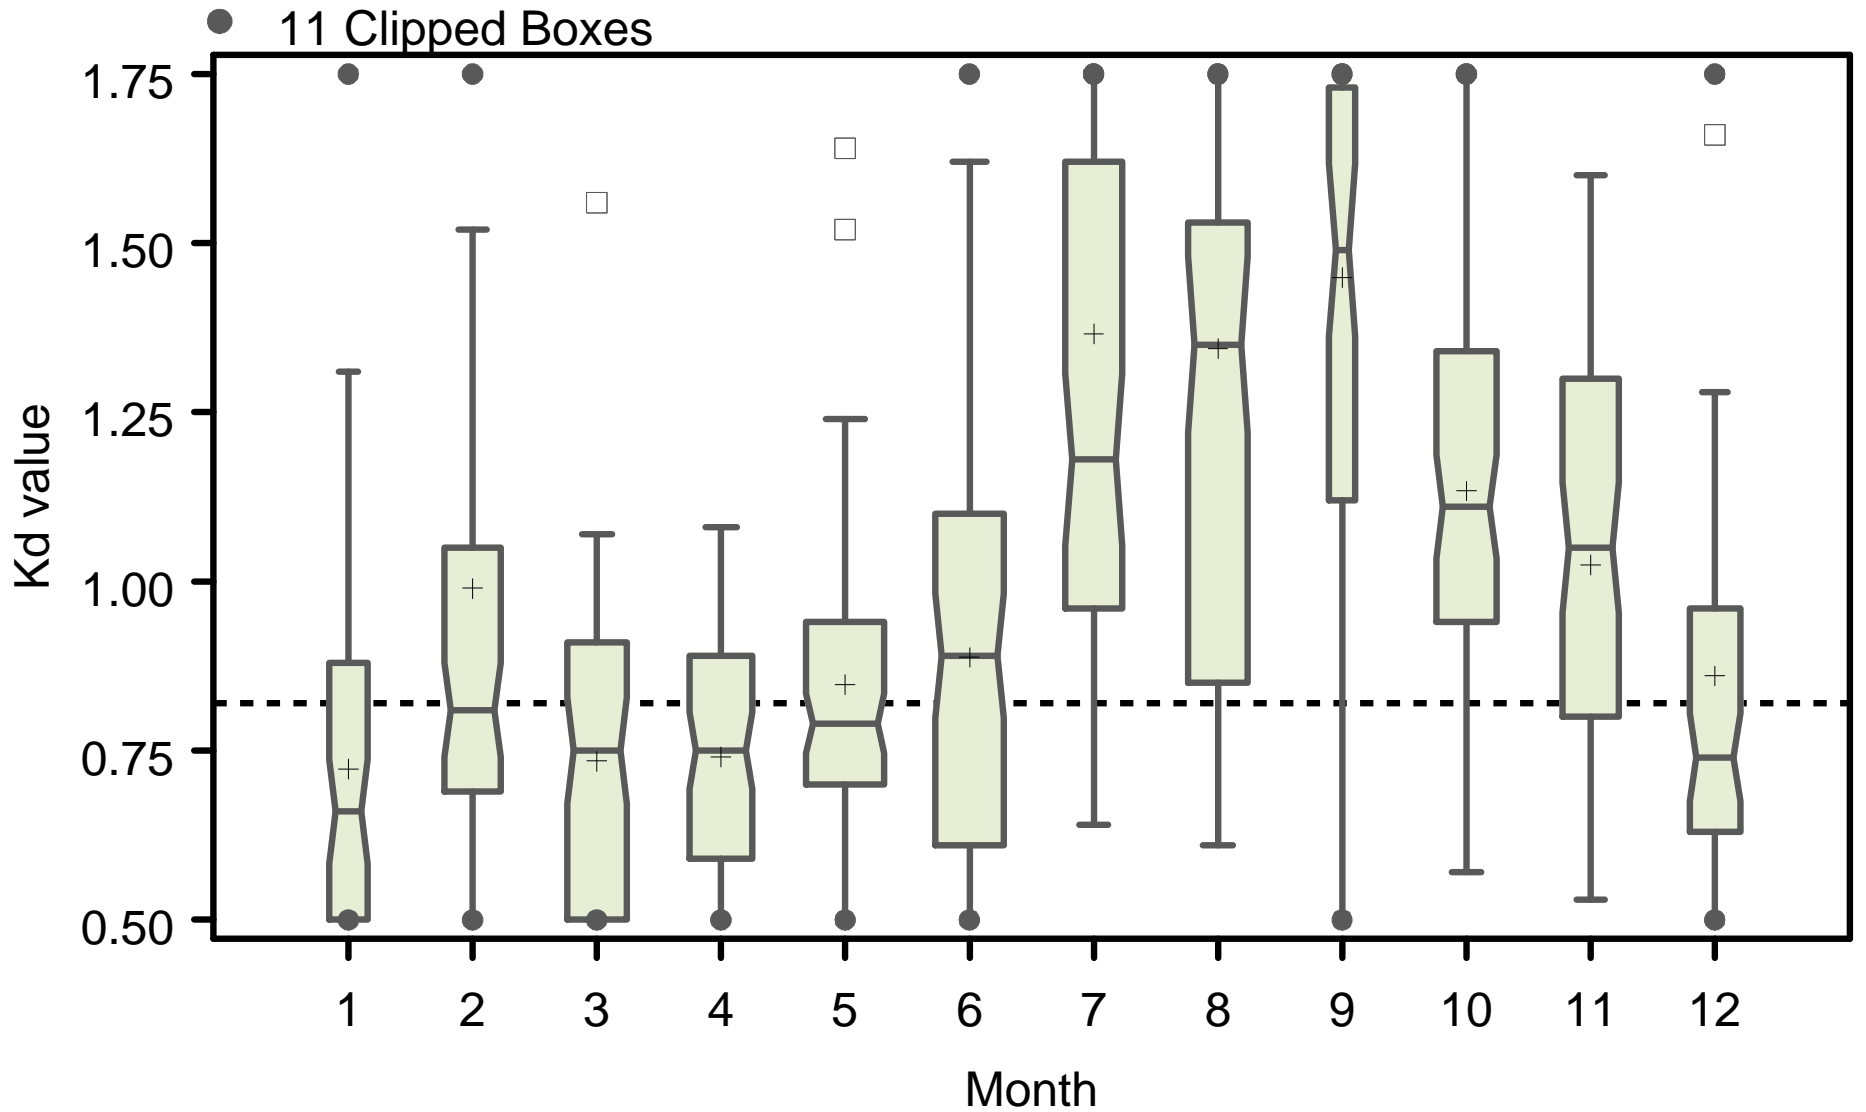


Box width varies with n

Horizontal line indicates the target(40%) Kd value

Distribution of Light Attenuation Coefficients by Sarasota County Water Clarity Segment

Segment=LSB Parameter=Kd

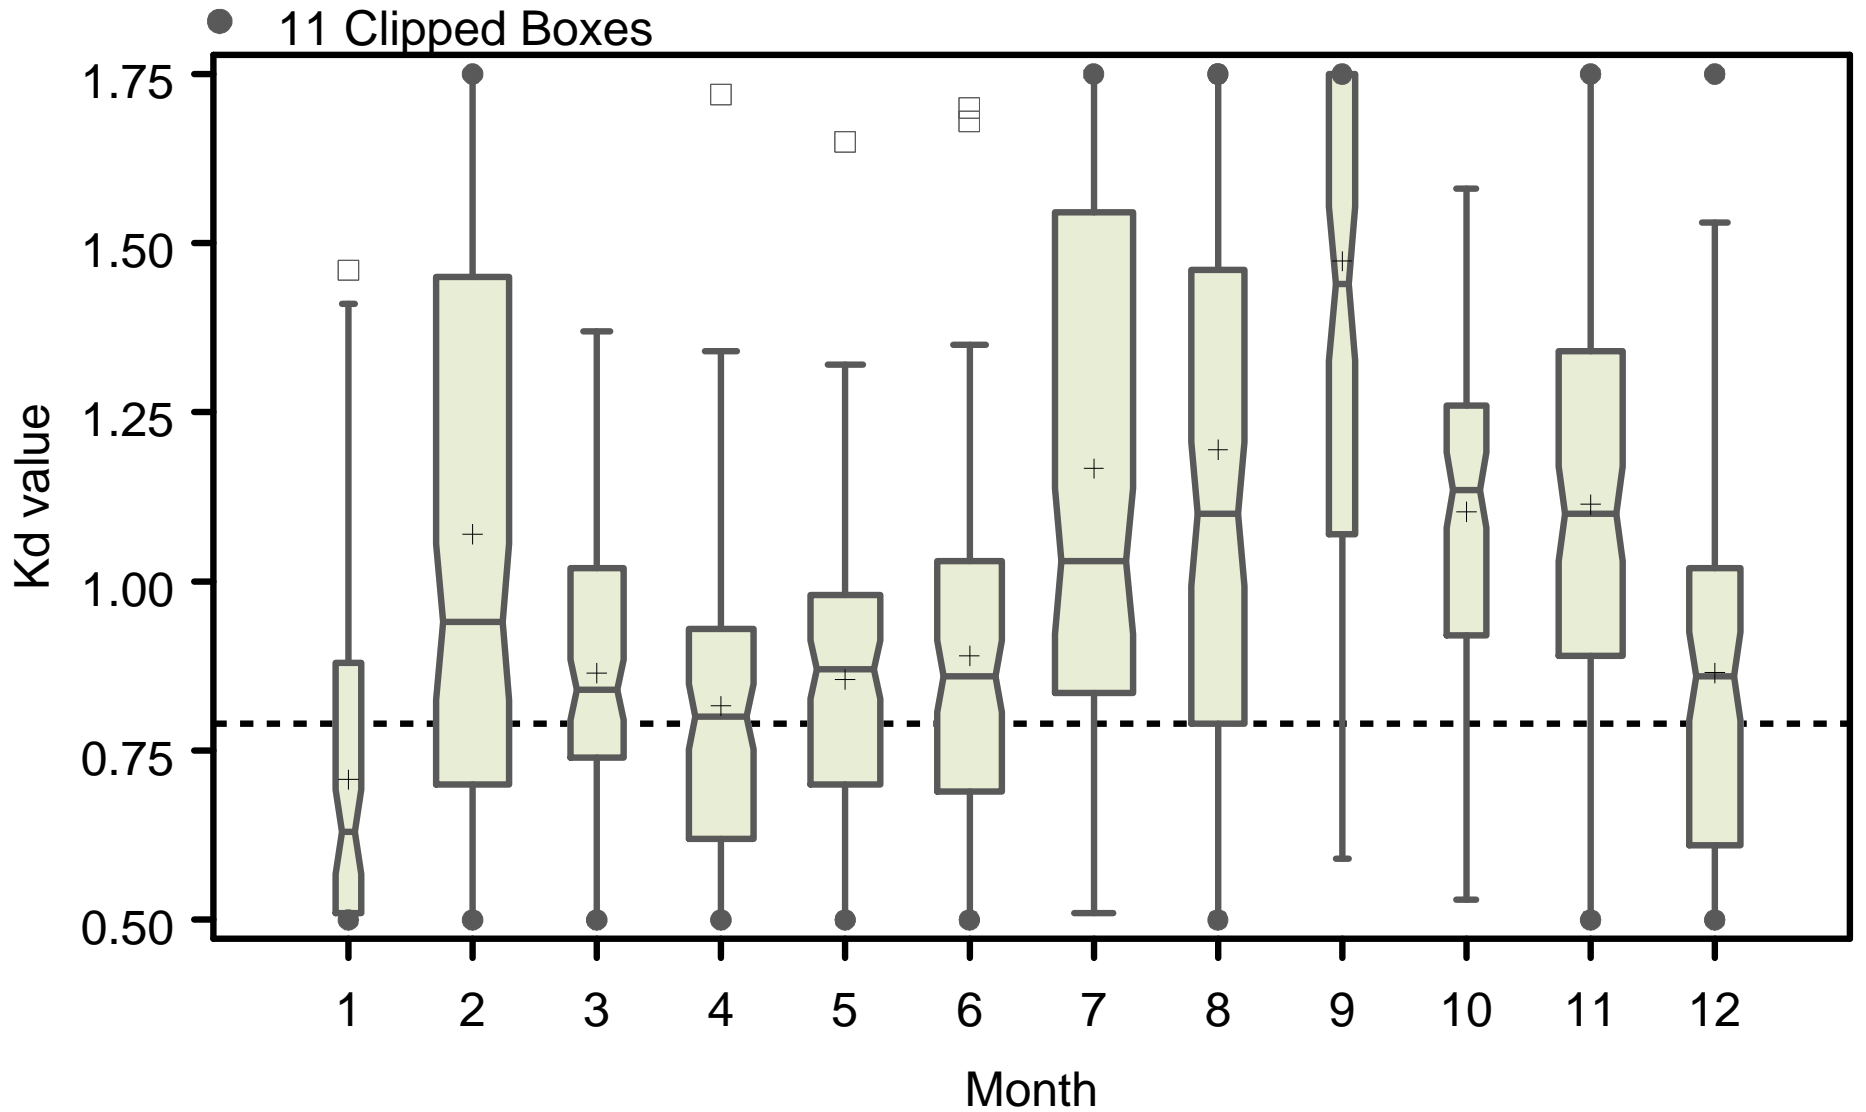


Box width varies with n

Horizontal line indicates the target(40%) Kd value

Distribution of Light Attenuation Coefficients by Sarasota County Water Clarity Segment

Segment=BB Parameter=Kd

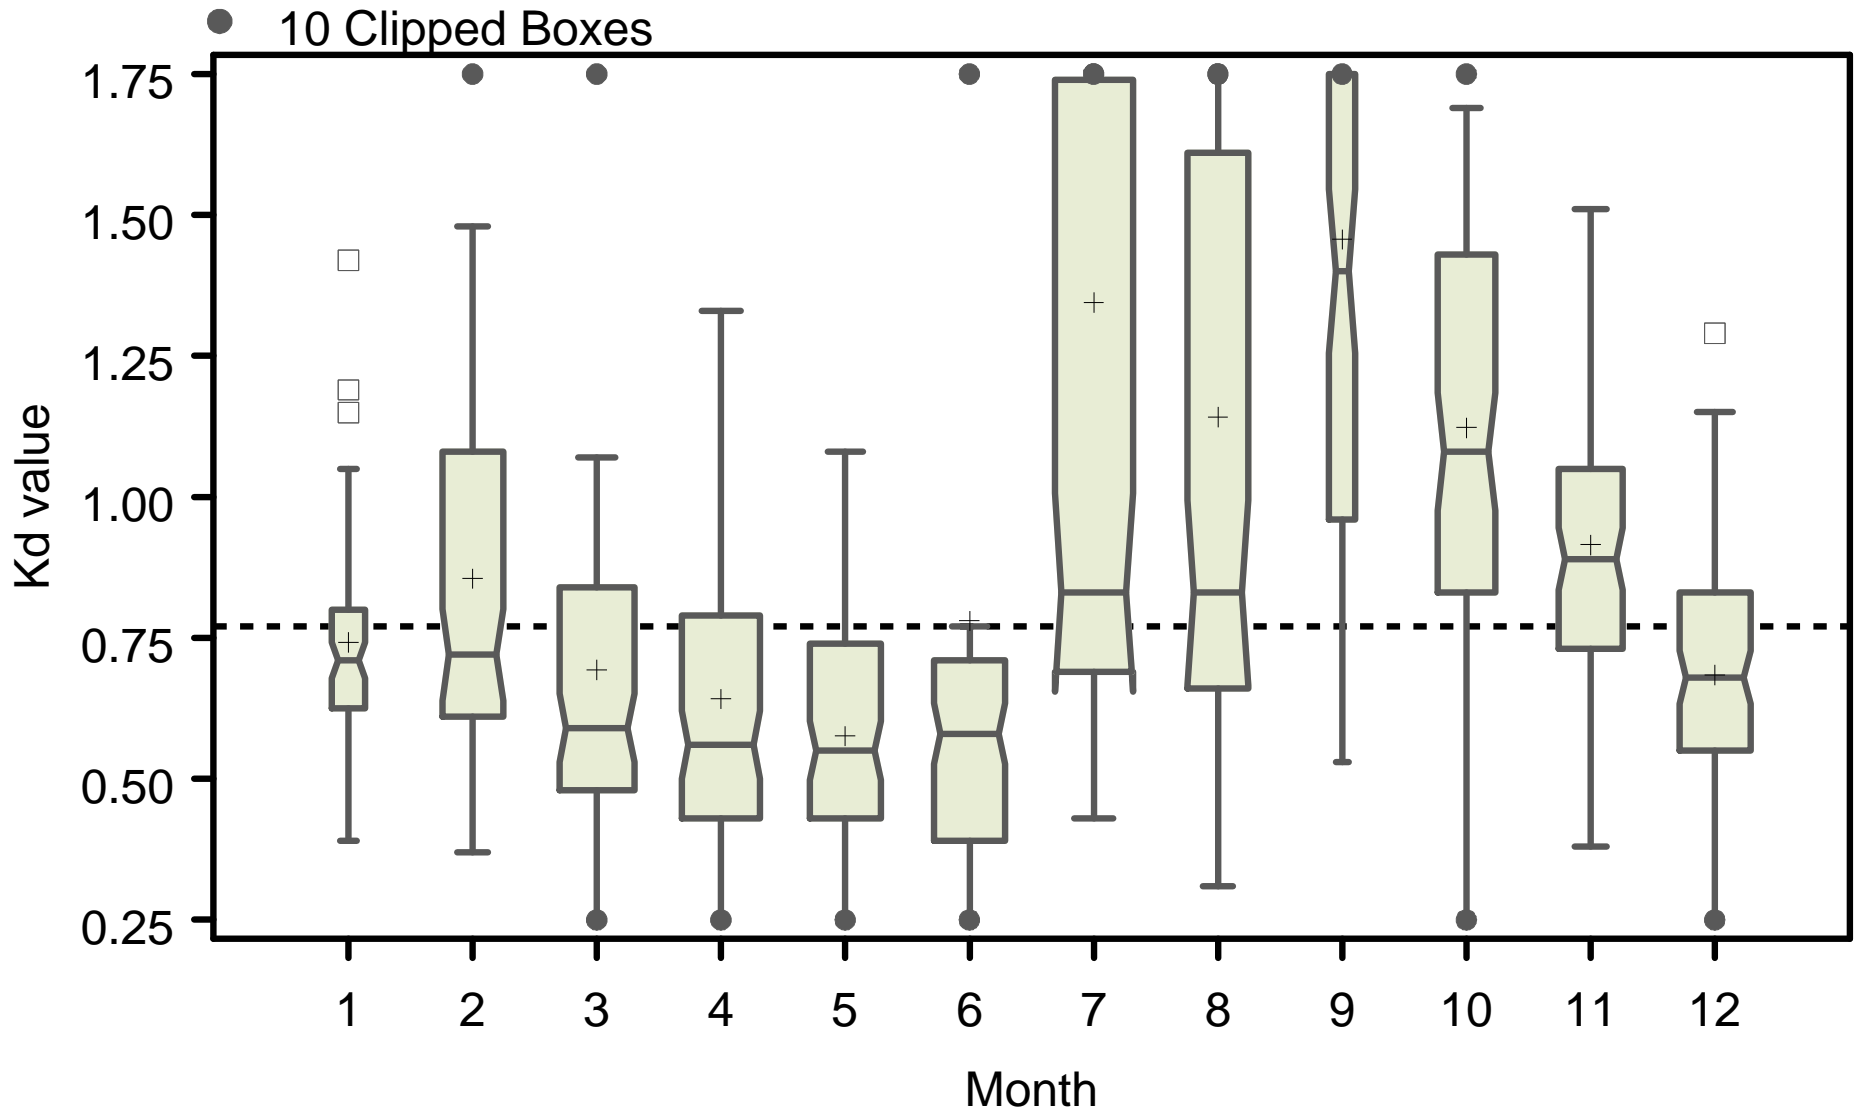


Box width varies with n

Horizontal line indicates the target(40%) Kd value

Distribution of Light Attenuation Coefficients by Sarasota County Water Clarity Segment

Segment=DRB Parameter=Kd

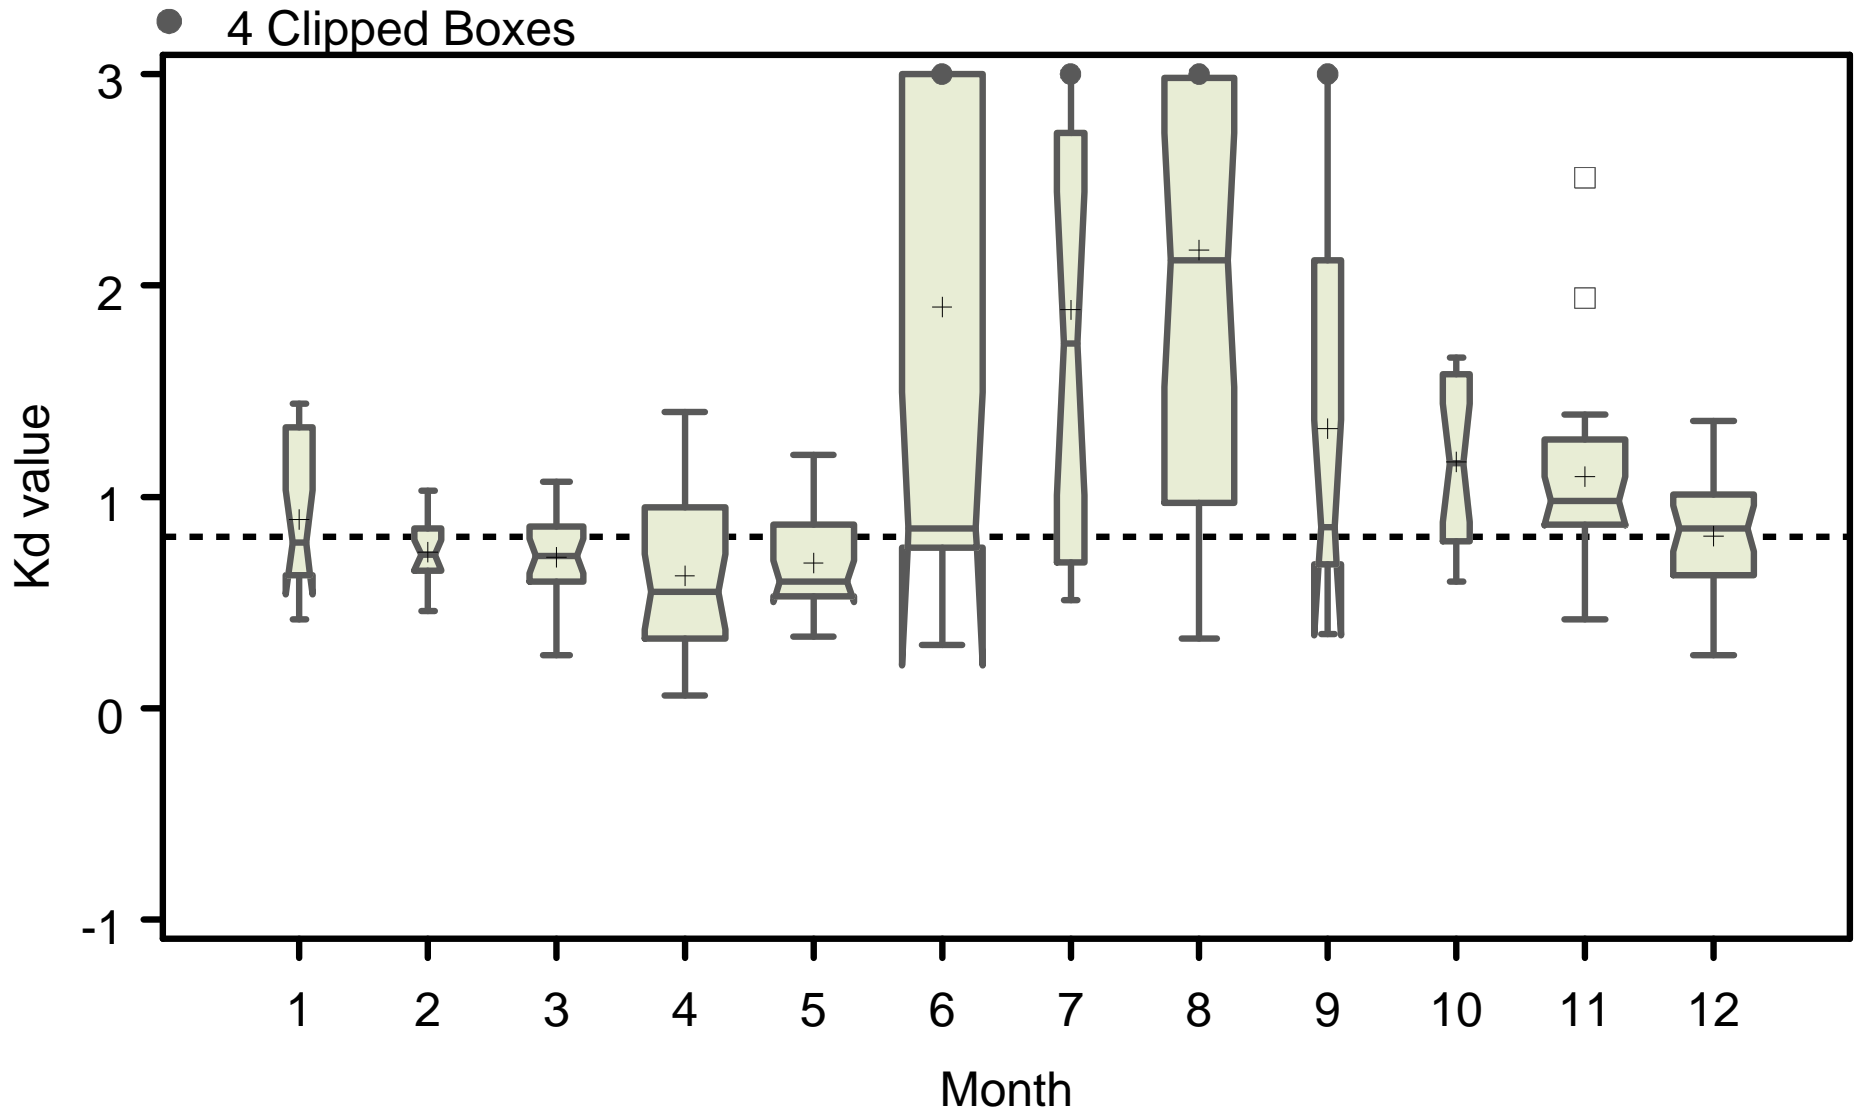


Box width varies with n

Horizontal line indicates the target(40%) Kd value

Distribution of Light Attenuation Coefficients by Sarasota County Water Clarity Segment

Segment=LB Parameter=Kd

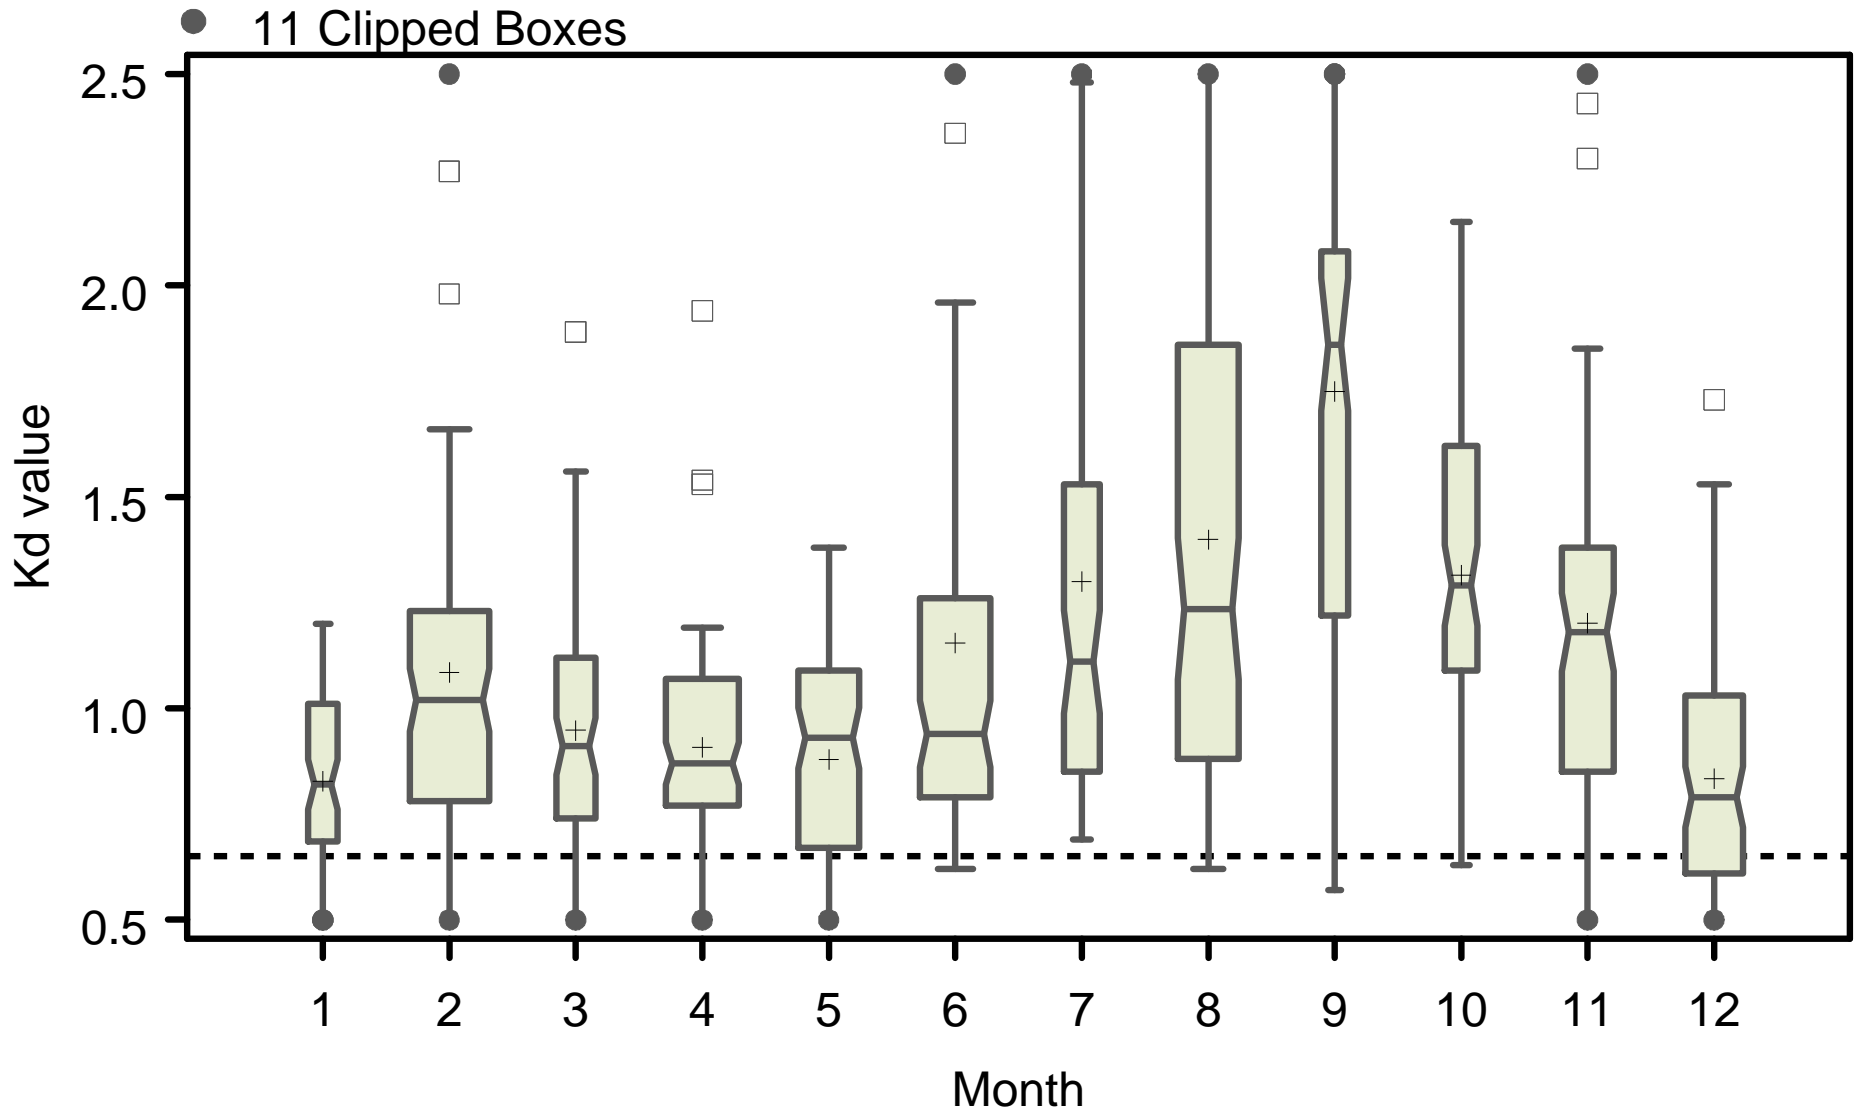

Box width varies with n

Horizontal line indicates the target(40%) Kd value